

**UPDATED INFLOW DESIGN FLOOD CONTROL SYSTEM PLAN**  
**PLANT GASTON ASH POND**  
**ALABAMA POWER COMPANY**

Section 257.82 of EPA's regulations requires the owner or operator of an existing or new CCR surface impoundment or any lateral expansion of a CCR surface impoundment to design, construct, operate and maintain an inflow design flood control system capable of safely managing flow during and following the peak discharge of the specified inflow design flood. The owner or operator also has to prepare a written plan documenting how the inflow flood control system has been designed and constructed to meet the requirements of this section of the rule.

The existing CCR surface impoundment referred to as the Plant Gaston Ash Pond is located at Alabama Power Company's Plant Gaston. The inflow design flood consists of the rainfall that falls within the limits of the surface impoundment, runoff from approximately 47 acres of adjoining watershed, and a nominal amount (relative to rainfall) of process flows. Stormwater is temporarily stored within the limits of the surface impoundment and discharged through an outlet structure consisting of an 8-foot concrete riser connected to a 36-inch diameter concrete spillway pipe.

The inflow design flood has been calculated using the Natural Resources Conservation Service method (also known as the Soil Conservation Service (SCS) method) using the PMF storm event required for a High hazard potential facility. Runoff curve number data was determined using Table 2-2A from the Urban Hydrology for Small Watersheds (TR-55). Appendix A and B from the TR-55 were used to determine the rainfall distribution methodology. Precipitation values were determined from NOAA's Precipitation Frequency Data Server (Atlas-14).


The NRCS provided information on the soil characteristics and hydrologic groups present at the site. It was determined that the hydrological group "B" should be used to best reflect the characteristics of the soils on site. This information was placed into Hydraflow Hydrographs 2013 and used to generate appropriate precipitation curves, storm basin routing information, and resulting rating curves to evaluate surface impoundment capacity.

Initial calculations indicated the unit exhibited a risk of overtopping a portion of the embankment located along the southeastern section of the surface impoundment near the primary spillway structure

during the inflow design storm. This section of the impoundment embankment has been modified through grading and the installation of an articulated concrete block armament system to allow it to operate as an auxiliary spillway during the design storm. The impoundment has sufficient spillway and storage capacity to adequately manage flow during and following the peak discharge from the design storm event.

The facility is operated subject to and in accordance with § 257.3-3 of EPA's regulations.

I hereby certify that the inflow design flood control system plan meets the requirements of 40 C.F.R. Part 257.82.

  
James C. Pegues, P.E.  
Licensed State of Alabama, PE No. 16516



**Inflow Design Control System Plan:  
Hydrologic and Hydraulic Calculation Summary**

for

***Plant Gaston Ash Pond***

Prepared by:

Southern Company Services  
Technical Services

---

Originator: *Curtis R. Upchurch* *6/5/18*  
Curtis R. Upchurch Date

Reviewer: *Jason S. Wilson FOR* *6/5/18*  
Jason S. Wilson Date

Approval: *James C. Pegues* *6/5/18*  
James C. Pegues Date

## 1.0 Purpose of Calculation

The purpose of this report is to demonstrate the hydraulic capacity of the subject CCR impoundment in order to prepare an inflow design flood control plan as required by the United States Environmental Protection Agency's (EPA) final rule for Disposal of CCR from Electric Utilities (EPA 40 CFR 257).

## 2.0 Summary of Conclusions

A hydrologic and hydraulic model was developed for the Plant Gaston Ash Pond to determine the hydraulic capacity of the impoundment. The design storm for the Plant Gaston Ash Pond is the PMP rainfall event. For this study, a storm length of 6-hours and the NRCS SITES distribution has been selected for all inflow design flood control plans. Note that the 6-hour storm duration is being used as historical PMP events in this region have been the result of shorter duration storm events. The results of routing a PMP, 6-hour rainfall event through the impoundment for current conditions are presented in Table 1 below:

Table 1-Flood Routing Results for Plant Gaston Ash Pond (Current)

Plant Gaston Area	Normal Pool EI (ft)	Top of embankment EI (ft)	Emergency Spillway Crest EI (ft)	Peak Water Surface Elevation (ft)	Freeboard* (ft)	Peak Inflow (cfs)	Peak Outflow (cfs)
Ash Pond	431.0 to 432.0**	Varies – low point @ 444.0	439.0	442.4	1.6	5819	2710

\*Freeboard is measured from the top of embankment to the peak water surface elevation

\*\*Assumed the higher normal pool elevation of 432.0 in calculations for conservative approach.

## 3.0 Methodology

### 3.1 HYDROLOGIC ANALYSES

The Plant Gaston Ash Pond is classified as a high hazard structure. The design storm for a high hazard structure is the PMP rainfall event. A summary of the design storm parameters and rainfall distribution methodology for these calculations is summarized below in Table 2.

Table 2(a) Plant Gaston Ash Pond Storm Precipitation

Hazard Classification	Return Frequency (years)	Storm Duration (hours)	Rainfall Total (Inches)	Rainfall Source	Storm Distribution
High	PMP	6	30.9	HMR - 51	NRCS SITES

The drainage area for the Plant Gaston Ash Pond was delineated based on LiDAR data and acquired for the Plant in 2013 and additional surveys in 2016. Runoff characteristics were developed based on the Soil Conservation Service (SCS) methodologies as outlined in TR-55. An overall SCS curve number for the drainage area was developed based on the National Engineering Handbook Part 630, Chapter 9 which provides a breakdown of curve numbers for each soil type and land use combination. Soil types were obtained from the USGS online soils database. Land use areas were delineated based on aerial photography. Time of Concentration calculations were developed based on the overland flow method as described in the National Engineering Handbook Part 630, Chapter 15.

A table of the pertinent basin characteristics of the Ash Pond is provided below in Table 3.

Table 3— Plant Gaston Ash Pond Hydrologic Information

Drainage Basin Area (acres)	317.6
Hydrologic Curve Number, CN	82
Hydrologic Methodology	SCS Method
Time of Concentration (minutes)	47.8
Hydrologic Software	Autodesk Hydraflow Hydrographs

The NRCS SITES rainfall distribution was used for the storm distribution. Runoff values were determined by importing the characteristics developed above into a hydrologic model with the Autodesk Hydraflow Hydrographs program.

Process flows from Plant Gaston were considered in this analysis. Based on normal plant operations, the Ash Pond receives an additional 60.1 MGD (93 cfs) of inflow from the Plant.

### 3.2 HYDRAULIC ANALYSES

Storage values for the Ash Pond were determined by developing a stage-storage relationship utilizing contour data for the ash pond and outlet canal. An arrangement of the ash pond and outlet canal is shown in the attached ash pond map in Section 4.5. Stormwater runoff and Plant process flows are collected from the ash sluicing areas and the ash stack and conveyed via a perimeter channel which runs along the north perimeter of the site parallel to a rail yard, turns and runs along the west side of the ash pond and then runs east in a defined canal following the southern boundary of the ash pond to a discharge point for release to the Coosa River. The outfall point has a vertical stop log riser located in a clear pool at the termination of the canal.

A summary of spillway information is presented below in Table 4.

Table 4— Plant Gaston Ash Pond Spillway Attribute Table

Spillway Component	US Invert EI (feet)	DS Invert EI (feet)	Dimension	Slope (ft/ft)	Length (ft)	Spillway Capacity (cfs)
Primary Concrete stop log riser 8 foot square	413.0*	407.35	Weir L = 14.0 ft., Weir EL 432.0 Outlet pipe = 36" diameter, RCP	0.0120	270*	173

\*Pipe system, riser, etc. has been retrofitted since initial construction. Some assumptions have been made for pipe lengths and inverts.

Based on the spillway attributes listed above, a rating curve was developed and inserted into Hydrflow Hydrographs software to analyze pond performance during the design storm. Results are shown in Table 1.

## 4.0 SUPPORTING INFORMATION

### 4.1 CURVE NUMBERS

#### 4.1.1 ASH STACK AREA

The image shows two overlapping software windows. The top window is titled "SCS Runoff Hydrograph" and contains the following fields:

- Descr. = Ash Stack Area
- Basin Data section:
  - Drainage Area (ac) ..... = 317.6
  - Curve Number (CN) .. = 83

The bottom window is titled "Composite CN" and displays a grid of area settings:

Area	Area (ac) .....	Curve No. CN .
Area 1	34.80	98
Area 2	224.30	85
Area 3	58.50	69
Area 4	0.00	0
Area 5	0.00	0
Area 6	0.00	0
Composite CN		83

Buttons for "Ok", "Clear", and "Exit" are visible at the bottom of the Composite CN window.

#### 4.1.2 AREA A BASIN

The image shows two overlapping dialog boxes. The top dialog, titled "SCS Runoff Hydrograph", has a "Descr." field containing "Area A". Under "Basin Data", the "Drainage Area (ac) ....." is 20.2 and the "Curve Number (CN) .." is 66. The bottom dialog, titled "Composite CN", contains six sub-sections for "Area 1" through "Area 6". Each sub-section has "Area (ac) ....." and "Curve No. CN ." fields, all of which are set to 0.00 and 0 respectively. At the bottom of the "Composite CN" dialog, the "Composite CN Curve No. CN ." field is highlighted in yellow and contains the value 0. There are "Ok", "Clear", and "Exit" buttons at the bottom right of the "Composite CN" dialog.

#### 4.1.3 AREA B BASIN

The image shows two overlapping dialog boxes. The top dialog, titled "SCS Runoff Hydrograph", has a "Descr." field containing "Area B". Under "Basin Data", the "Drainage Area (ac) ....." is 9 and the "Curve Number (CN) .." is 65. The bottom dialog, titled "Composite CN", contains six sub-sections for "Area 1" through "Area 6". Each sub-section has "Area (ac) ....." and "Curve No. CN ." fields, all of which are set to 0.00 and 0 respectively. At the bottom of the "Composite CN" dialog, the "Composite CN Curve No. CN ." field is highlighted in yellow and contains the value 0. There are "Ok", "Clear", and "Exit" buttons at the bottom right of the "Composite CN" dialog.

4.1.4 AREA C BASIN

The image shows two overlapping software dialog boxes. The top dialog, titled "SCS Runoff Hydrograph", has a "Descr." field containing "Area C". Below it, the "Basin Data" section includes "Drainage Area (ac) ....." set to "17.3" and "Curve Number (CN) .." set to "82". The bottom dialog, titled "Composite CN", contains six sub-sections for "Area 1" through "Area 6". Each sub-section has "Area (ac) ....." and "Curve No. CN ." fields, all of which are currently set to "0.00" and "0" respectively. At the bottom of this dialog, a "Composite CN" section shows "Curve No. CN ." set to "0". Three buttons labeled "Ok", "Clear", and "Exit" are located at the bottom right of the "Composite CN" dialog.


Area	Area (ac) .....	Curve No. CN .
Area 1	0.00	0
Area 2	0.00	0
Area 3	0.00	0
Area 4	0.00	0
Area 5	0.00	0
Area 6	0.00	0
Composite CN		0



## 4.2 STAGE-STORAGE TABLES & CURVES

### ASH POND AND OUTLET CANAL

Contour Elevation	Surface Area Acres	Volume Acre-Feet
432	4.46	0.00
433	16.31	5.58
434	22.96	23.85
435	36.83	55.43
436	40.70	115.44
437	46.76	140.81
438	51.15	189.89
439	54.74	239.28
440	58.21	289.44
441	60.45	340.80
442	62.65	393.63
443	64.95	448.39
444	70.55	505.87
445	75.51	578.84

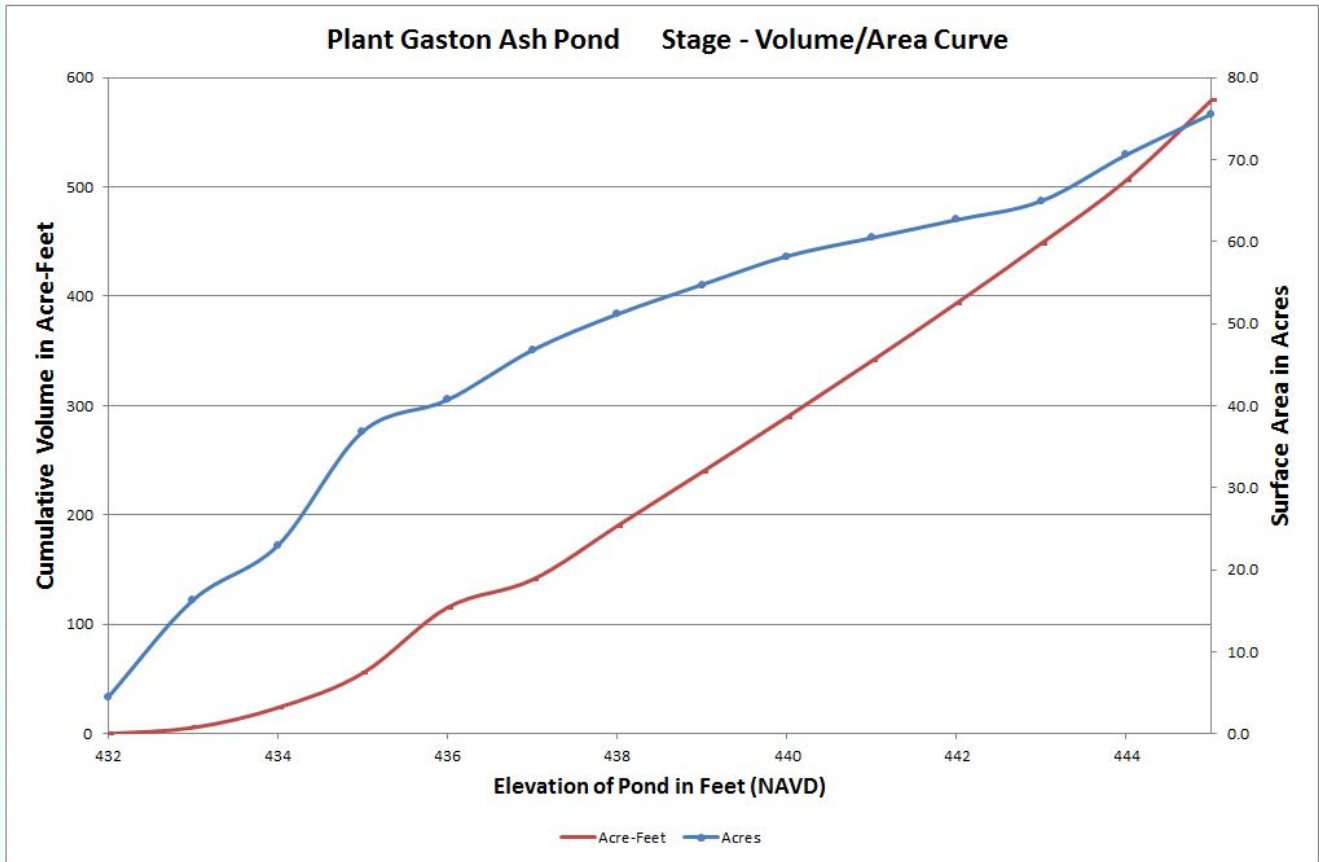

### 4.3 TIME OF CONCENTRATION

#### FORMULAS FOR SHEET FLOW, SHALLOW CONCENTRATED FLOW, CHANNEL FLOW, AND FLOW THRU WATER

SCS TR-55 Time of Concentration Computations Report	
=====	
Sheet Flow Equation	Channel Flow Equation
-----	-----
$T_c = (0.007 * ((n * L_f)^{0.8})) / ((P^{0.5}) * (Sf^{0.4}))$	$V = (1.49 * (R^{(2/3)}) * (Sf^{0.5})) / n$
	$R = A_q / W_p$
Where:	$T_c = (L_f / V) / (3600 \text{ sec/hr})$
$T_c = \text{Time of Concentration (hrs)}$	
$n = \text{Manning's Roughness}$	Where:
$L_f = \text{Flow Length (ft)}$	$T_c = \text{Time of Concentration (hrs)}$
$P = 2 \text{ yr, 24 hr Rainfall (inches)}$	$L_f = \text{Flow Length (ft)}$
$Sf = \text{Slope (ft/ft)}$	$R = \text{Hydraulic Radius (ft)}$
	$A_q = \text{Flow Area (ft}^2\text{)}$
Shallow Concentrated Flow Equation	$W_p = \text{Wetted Perimeter (ft)}$
-----	$V = \text{Velocity (ft/sec)}$
$V = 16.1345 * (Sf^{0.5}) \text{ (unpaved surface)}$	$Sf = \text{Slope (ft/ft)}$
$V = 20.3282 * (Sf^{0.5}) \text{ (paved surface)}$	$n = \text{Manning's Roughness}$
$V = 15.0 * (Sf^{0.5}) \text{ (grassed waterway surface)}$	
$V = 10.0 * (Sf^{0.5}) \text{ (nearly bare \& untilled surface)}$	Water Travel Velocity Equation
$V = 9.0 * (Sf^{0.5}) \text{ (cultivated straight rows surface)}$	-----
$V = 7.0 * (Sf^{0.5}) \text{ (short grass pasture surface)}$	$V = (g * D)^{0.5}$
$V = 5.0 * (Sf^{0.5}) \text{ (woodland surface)}$	$T_c = ((L_f / V) / 60 \text{ sec/min})$
$V = 2.5 * (Sf^{0.5}) \text{ (forest w/heavy litter surface)}$	
$T_c = (L_f / V) / (3600 \text{ sec/hr})$	Where:
	$T_c = \text{Time of Concentration (hrs)}$
Where:	$D = \text{Mean Depth (ft)}$
$T_c = \text{Time of Concentration (hrs)}$	$g = \text{Gravitational Constant (32.2 ft/sec)}$
$L_f = \text{Flow Length (ft)}$	$L_f = \text{Flow Length (ft)}$
$V = \text{Velocity (ft/sec)}$	$R = \text{Hydraulic Radius (ft)}$
$Sf = \text{Slope (ft/ft)}$	$V = \text{Velocity (ft/sec)}$

### 4.3.1 ASH STACK AREA

## TR55 Tc Worksheet

Hydroflow Hydrographs Extension for AutoCAD® Civil 3D® 2016 by Autodesk, Inc. v10.5

### Hyd. No. 1

Ash Stack Area

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>
<b>Sheet Flow</b>				
Manning's n-value	= 0.020	0.011	0.011	
Flow length (ft)	= 100.0	0.0	0.0	
Two-year 24-hr precip. (in)	= 4.11	0.00	0.00	
Land slope (%)	= 1.00	0.00	0.00	
<b>Travel Time (min)</b>	<b>= 2.28</b>	<b>+ 0.00</b>	<b>+ 0.00</b>	<b>= 2.28</b>
<b>Shallow Concentrated Flow</b>				
Flow length (ft)	= 2770.00	200.00	0.00	
Watercourse slope (%)	= 3.80	4.11	0.00	
Surface description	= Unpaved	Unpaved	Paved	
Average velocity (ft/s)	= 3.15	3.27	0.00	
<b>Travel Time (min)</b>	<b>= 14.68</b>	<b>+ 1.02</b>	<b>+ 0.00</b>	<b>= 15.70</b>
<b>Channel Flow</b>				
X sectional flow area (sqft)	= 67.13	0.00	0.00	
Wetted perimeter (ft)	= 27.04	0.00	0.00	
Channel slope (%)	= 0.27	0.00	0.00	
Manning's n-value	= 0.030	0.015	0.015	
Velocity (ft/s)	= 4.75	0.00	0.00	
Flow length (ft)	((0))6210.0	0.0	0.0	
<b>Travel Time (min)</b>	<b>= 21.81</b>	<b>+ 0.00</b>	<b>+ 0.00</b>	<b>= 21.81</b>
<b>Total Travel Time, Tc .....</b>				<b>39.80 min</b>

Flow thru Water Computations	
-----	
-	Subarea A
Flow Length (ft):	4400
Average Depth (ft):	5
Velocity (ft/sec):	12.7
Computed Flow Time (minutes):	5.8
=====	
Total TOC (minutes):	45,6
=====	

## 4.3.2 AREA A

10

### TR55 Tc Worksheet

Hydroflow Hydrographs Extension for AutoCAD® Civil 3D® 2013 by Autodesk, Inc. v10

#### Hyd. No. 5

Area A

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>
<b>Sheet Flow</b>				
Manning's n-value	= 0.400	0.011	0.011	
Flow length (ft)	= 150.0	0.0	0.0	
Two-year 24-hr precip. (in)	= 4.11	0.00	0.00	
Land slope (%)	= 7.40	0.00	0.00	
<b>Travel Time (min)</b>	<b>= 15.53</b>	<b>+ 0.00</b>	<b>+ 0.00</b>	<b>= 15.53</b>
<b>Shallow Concentrated Flow</b>				
Flow length (ft)	= 940.00	0.00	0.00	
Watercourse slope (%)	= 7.40	0.00	0.00	
Surface description	= Paved	Paved	Paved	
Average velocity (ft/s)	= 5.53	0.00	0.00	
<b>Travel Time (min)</b>	<b>= 2.83</b>	<b>+ 0.00</b>	<b>+ 0.00</b>	<b>= 2.83</b>
<b>Channel Flow</b>				
X sectional flow area (sqft)	= 0.00	0.00	0.00	
Wetted perimeter (ft)	= 0.00	0.00	0.00	
Channel slope (%)	= 0.00	0.00	0.00	
Manning's n-value	= 0.018	0.015	0.015	
Velocity (ft/s)	= 0.00	0.00	0.00	
Flow length (ft)	((0))0.0	0.0	0.0	
<b>Travel Time (min)</b>	<b>= 0.00</b>	<b>+ 0.00</b>	<b>+ 0.00</b>	<b>= 0.00</b>
<b>Total Travel Time, Tc</b> .....				<b>18.36 min</b>

### 4.3.3 AREA B

#### TR55 Tc Worksheet

14

Hydroflow Hydrographs Extension for AutoCAD® Civil 3D® 2013 by Autodesk, Inc. v10

#### Hyd. No. 7

Area B

Description	A	B	C	Totals
<b>Sheet Flow</b>				
Manning's n-value	= 0.400	0.011	0.011	
Flow length (ft)	= 100.0	0.0	0.0	
Two-year 24-hr precip. (in)	= 4.11	0.00	0.00	
Land slope (%)	= 10.60	0.00	0.00	
<b>Travel Time (min)</b>	<b>= 9.72</b>	<b>+ 0.00</b>	<b>+ 0.00</b>	<b>= 9.72</b>
<b>Shallow Concentrated Flow</b>				
Flow length (ft)	= 626.00	0.00	0.00	
Watercourse slope (%)	= 10.60	0.00	0.00	
Surface description	= Unpaved	Paved	Paved	
Average velocity (ft/s)	= 5.25	0.00	0.00	
<b>Travel Time (min)</b>	<b>= 1.99</b>	<b>+ 0.00</b>	<b>+ 0.00</b>	<b>= 1.99</b>
<b>Channel Flow</b>				
X sectional flow area (sqft)	= 0.00	0.00	0.00	
Wetted perimeter (ft)	= 0.00	0.00	0.00	
Channel slope (%)	= 0.00	0.00	0.00	
Manning's n-value	= 0.018	0.015	0.015	
Velocity (ft/s)	= 0.00	0.00	0.00	
			0.00	
Flow length (ft)	((0))0.0	0.0	0.0	
<b>Travel Time (min)</b>	<b>= 0.00</b>	<b>+ 0.00</b>	<b>+ 0.00</b>	<b>= 0.00</b>
<b>Total Travel Time, Tc</b> .....				<b>11.71 min</b>

### 4.3.4 AREA C

#### TR55 Tc Worksheet

Hydreflow Hydrographs Extension for AutoCAD® Civil 3D® 2013 by Autodesk, Inc. v10

#### Hyd. No. 10

Area C

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>
<b>Sheet Flow</b>				
Manning's n-value	= 0.240	0.011	0.011	
Flow length (ft)	= 50.0	0.0	0.0	
Two-year 24-hr precip. (in)	= 4.11	0.00	0.00	
Land slope (%)	= 5.00	0.00	0.00	
<b>Travel Time (min)</b>	<b>= 5.01</b>	<b>+</b> <b>0.00</b>	<b>+</b> <b>0.00</b>	<b>= 5.01</b>
<b>Shallow Concentrated Flow</b>				
Flow length (ft)	= 1300.00	0.00	0.00	
Watercourse slope (%)	= 5.60	0.00	0.00	
Surface description	= Unpaved	Paved	Paved	
Average velocity (ft/s)	= 3.82	0.00	0.00	
<b>Travel Time (min)</b>	<b>= 5.67</b>	<b>+</b> <b>0.00</b>	<b>+</b> <b>0.00</b>	<b>= 5.67</b>
<b>Channel Flow</b>				
X sectional flow area (sqft)	= 0.00	0.00	0.00	
Wetted perimeter (ft)	= 0.00	0.00	0.00	
Channel slope (%)	= 0.00	0.00	0.00	
Manning's n-value	= 0.018	0.015	0.015	
Velocity (ft/s)	= 0.00	0.00	0.00	
Flow length (ft)	{{0}}0.0	0.0	0.0	
<b>Travel Time (min)</b>	<b>= 0.00</b>	<b>+</b> <b>0.00</b>	<b>+</b> <b>0.00</b>	<b>= 0.00</b>
<b>Total Travel Time, Tc .....</b>				<b>10.70 min</b>

## 4.4 RATING CURVES

### 4.4.1 ASH POND & OUTLET CANAL RATING CURVE

#### Pond Report

4

Hydroflow Hydrographs Extension for AutoCAD® Civil 3D® 2013 by Autodesk, Inc. v10

Wednesday, 10 / 12 / 2016

#### Pond No. 1 - Ash Pond Pool & Canal

##### Pond Data

Pond storage is based on user-defined values.

##### Stage / Storage Table

Stage (ft)	Elevation (ft)	Contour area (sqft)	Incr. Storage (cuft)	Total storage (cuft)
0.00	432.00	n/a	0	0
1.00	433.00	n/a	243,063	243,063
2.00	434.00	n/a	795,784	1,038,847
3.00	435.00	n/a	1,375,547	2,414,394
4.00	436.00	n/a	2,614,109	5,028,503
5.00	437.00	n/a	1,105,094	6,133,597
6.00	438.00	n/a	2,137,871	8,271,468
7.00	439.00	n/a	2,151,792	10,423,260
8.00	440.00	n/a	2,184,900	12,608,160
9.00	441.00	n/a	2,237,210	14,845,380
10.00	442.00	n/a	2,301,370	17,146,730
11.00	443.00	n/a	2,185,010	19,331,740
12.00	444.00	n/a	2,704,070	22,035,810
13.00	445.00	n/a	3,178,580	25,214,370

##### Culvert / Orifice Structures

	[A]	[B]	[C]	[PrfRsr]
Rise (in)	= 36.00	inactive	inactive	inactive
Span (in)	= 36.00	0.00	0.00	0.00
No. Barrels	= 1	0	0	0
Invert El. (ft)	= 413.00	0.00	0.00	0.00
Length (ft)	= 270.00	0.00	0.00	0.00
Slope (%)	= 1.12	0.00	0.00	n/a
N-Value	= 013	013	013	n/a
Orifice Coeff.	= 0.80	0.80	0.80	0.80
Multi-stage	= n/a	No	No	No

##### Weir Structures

	[A]	[B]	[C]	[D]
Crest Len (ft)	= 14.00	1500.00	inactive	inactive
Crest El. (ft)	= 432.00	444.00	0.00	0.00
Weir Coeff.	= 3.33	3.33	3.33	3.33
Weir Type	= 1	Rect	Rect	—
Multi-stage	= Yes	No	No	No
Exfil. (in/hr)	= 0.000 (by Weir elev)			
TW Elev. (ft)	= 0.00			

##### Stage / Storage / Discharge Table

Note: Culvert/Orifice culverts are analyzed under: Inlet (ic) and outlet (oc) control. Weir rises checked for orifice conditions (ic) and submerged (s).

Stage ft	Storage cuft	Elevation ft	Civ A o/c	Civ B o/c	Civ C o/c	PrfRsr o/c	Wr A o/c	Wr B o/c	Wr C o/c	Wr D o/c	Exfil o/c	User o/c	Total o/c
0.00	0	432.00	0.00	—	—	—	0.00	0.00	—	—	—	—	0.000
1.00	243,063	433.00	133.37 oc	—	—	—	46.62	0.00	—	—	—	—	46.62
2.00	1,038,847	434.00	133.37 oc	—	—	—	93.15 ic	0.00	—	—	—	—	93.15
3.00	2,414,394	435.00	133.37 oc	—	—	—	114.08 ic	0.00	—	—	—	—	114.08
4.00	5,028,503	436.00	133.37 oc	—	—	—	131.73 ic	0.00	—	—	—	—	131.73
5.00	6,133,597	437.00	149.47 oc	—	—	—	149.45 s	0.00	—	—	—	—	149.45
6.00	8,271,468	438.00	152.72 oc	—	—	—	152.68 s	0.00	—	—	—	—	152.68
7.00	10,423,260	439.00	155.83 oc	—	—	—	155.77 s	0.00	—	—	—	—	155.77
8.00	12,608,160	440.00	158.85 oc	—	—	—	158.80 s	0.00	—	—	—	—	158.80
9.00	14,845,380	441.00	161.79 oc	—	—	—	161.78 s	0.00	—	—	—	—	161.78
10.00	17,146,730	442.00	164.68 oc	—	—	—	164.50 s	0.00	—	—	—	—	164.50
11.00	19,331,740	443.00	167.50 oc	—	—	—	167.48 s	0.00	—	—	—	—	167.48
12.00	22,035,810	444.00	170.28 oc	—	—	—	170.18 s	0.00	—	—	—	—	170.18
13.00	25,214,370	445.00	173.01 oc	—	—	—	172.46 s	4995.00	—	—	—	—	5167.46

## 4.4.2 ASH POND & OUTLET CANAL INFLOW HYDROGRAPH

### Hydrograph Report

14


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2013 by Autodesk, Inc. v10

Tuesday, 07 / 18 / 2017

#### Hyd. No. 9

Add Off-Site Area C

Hydrograph type	= Combine	Peak discharge	= 5819.46 cfs
Storm frequency	= PMP	Time to peak	= 165 min
Time interval	= 3 min	Hyd. volume	= 39,911,644 cuft
Inflow hyds.	= 7, 8	Contrib. drain. area	= 17.300 ac

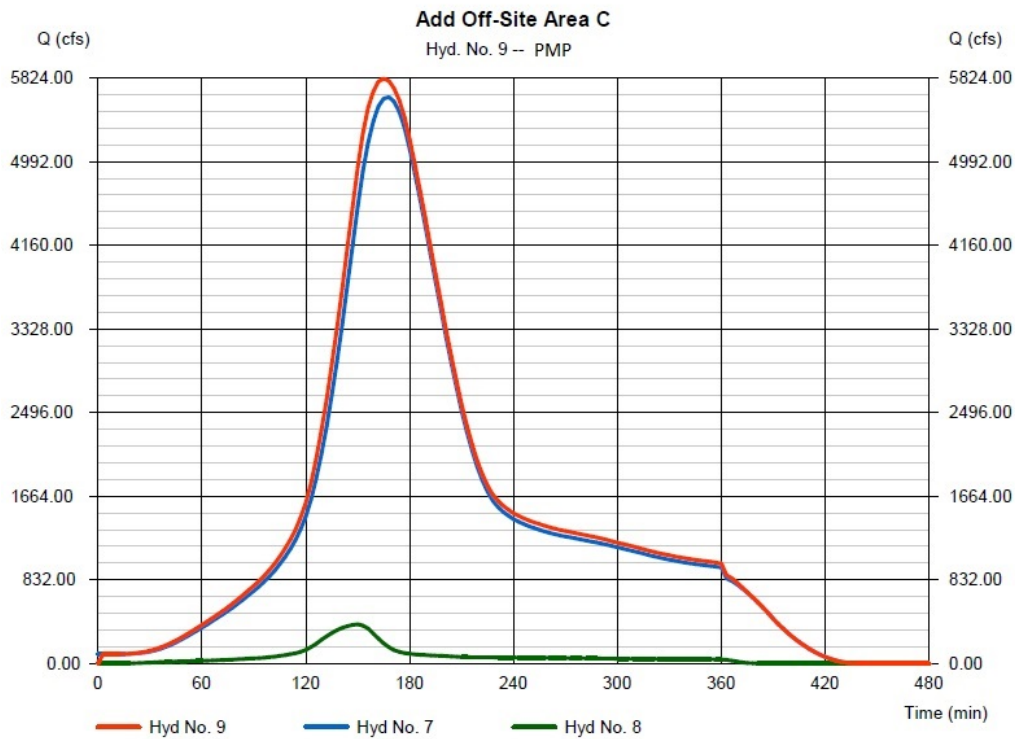



### 4.4.3 ASH POND & OUTLET CANAL DISCHARGE HYDROGRAPH

## Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2013 by Autodesk, Inc. v10


Tuesday, 07 / 18 / 2017

### Hyd. No. 10

Pool & Canal

Hydrograph type	= Reservoir	Peak discharge	= 2709.48 cfs
Storm frequency	= PMP	Time to peak	= 207 min
Time interval	= 3 min	Hyd. volume	= 39,883,316 cuft
Inflow hyd. No.	= 9 - Add Off-Site Area C	Max. Elevation	= 442.44 ft
Reservoir name	= Ash Pond Pool & Canal	Max. Storage	= 19,864,670 cuft

Storage Indication method used.

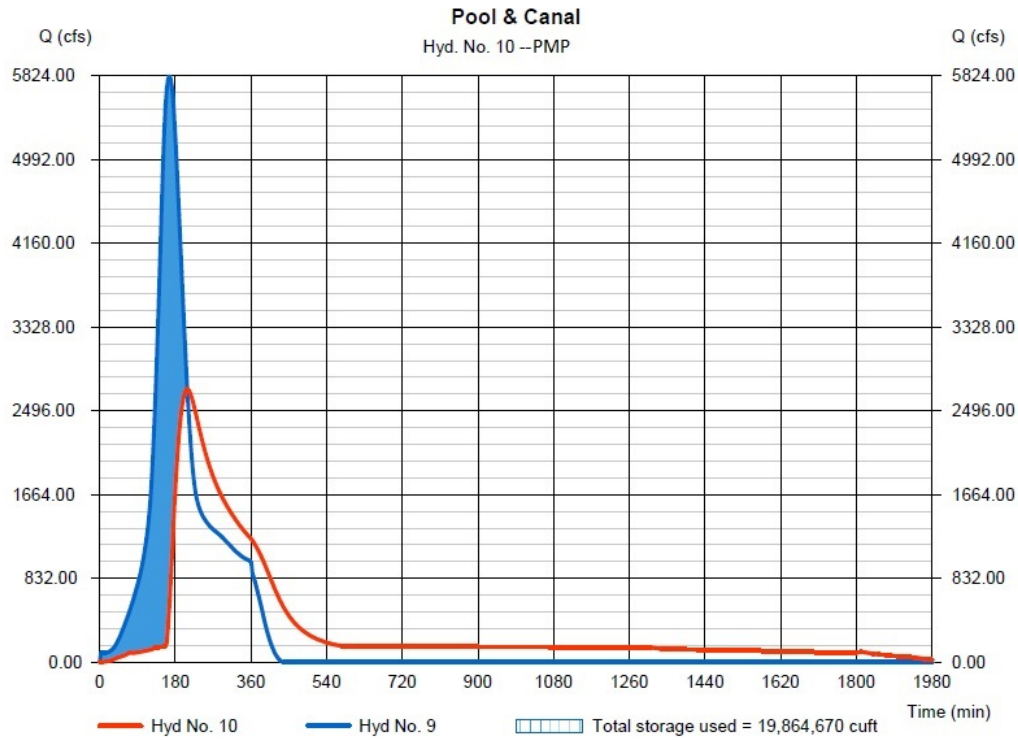

#### 4.4.4 ASH POND & OUTLET CANAL DEPTH VS TIME

### Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2016 by Autodesk, Inc. v10.5


Thursday, 05 / 31 / 2018

#### Hyd. No. 10

Pool & Canal

Hydrograph type	= Reservoir	Peak discharge	= 2709.48 cfs
Storm frequency	= PMP	Time to peak	= 3.45 hrs
Time interval	= 3 min	Hyd. volume	= 39,883,316 cuft
Inflow hyd. No.	= 9 - Add Off-Site Area C	Max. Elevation	= 442.44 ft
Reservoir name	= Ash Pond Pool & Canal	Max. Storage	= 19,864,670 cuft

Storage Indication method used.

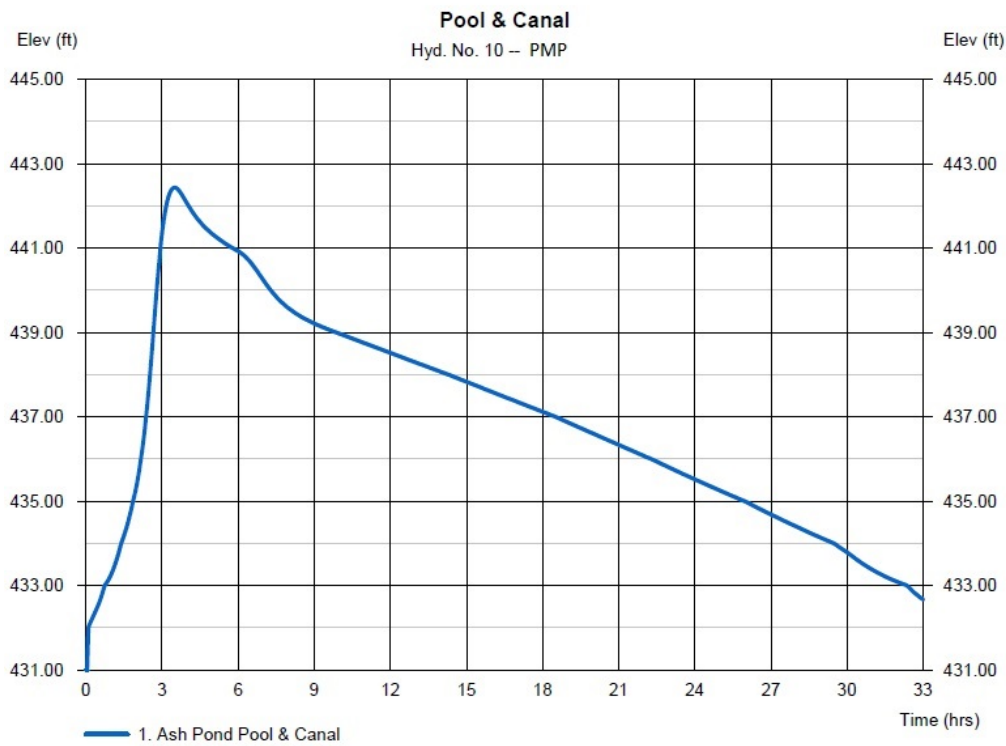

4.5 DRAINAGE MAP

